

Power Quality Improvement by using Active Power Filters in EV Charging Stations

1 D Vannurappa, 2 A R Narendra Reddy, 3 P Praveen, 4 B Satish Babu, 5 T Tom sai,
1 Assistant Professor, 2,3,4,5 B-tech student Scholar
1,2,3,4,5 Department of Electrical & Electronics Engineering,
1,2,3,4,5 G.Pullaiah College of Engineering and Technology, Nandikotkur Rd,
near Venkayapalle, Pasupula Village, Kurnool, Andhra Pradesh 518002.

Abstract: One of the primary reasons for the introduction of electric cars into the market is the concern over greenhouse gas emissions and their contribution to global warming. The purpose of creating electric cars that reduced or eliminated exhaust emissions was to help combat this issue. These EVs by using Active Power Filters have a major impact on the power grid and distribution networks and due to the consequences of huge power demand to recharge their batteries. Large number of EVs by using Active Power Filters charging station when integrates with the utility grid, it produces harmonics, affect the voltage profile, finally affects the power quality. In this paper, the impact of electric vehicle by using Active Power Filters charging station on distribution network is analyzed. The simulation model and the results are analyzed using MATLAB/Simulink.

Keywords: Electrical Vehicles (EV), EV charging station, Distribution network


1. Introduction

Electric vehicles (EV) represent the most likely successor to conventional internal combustion engine vehicles. Over the past few years, sales have steadily increased, and this trend is expected to continue over the next few years [1]. To perform the battery charging process, EVs rely on a charging station, which can be found at home, at work, or at a public charging station. Typically, on-board chargers are slow chargers, while off-board chargers are fast chargers. Both solutions come with advantages and disadvantages [2]. On-board chargers have limited power ratings due to space, weight, and cost restrictions, while off-board chargers can be designed for high charging rates with fewer restrictions. The different charging modes and their characteristics are summarized in Table 1 (from IEC 61851-1 [3]). Current forecasts, driven by European Distribution System Operators (DSO), suggest that, by 2030, AC power levels are expected to increase only slightly, since they will be constrained by existing connection points. However, fast DC chargers will grow to more than 150 kW (even up to 300 kW) [4].

Although most EV charging processes today take place at homes, it is clear that access to public fast DC charging stations could help mitigate the so-called 'range anxiety', which is one of the reasons considered for doubting buying an electric

car. Therefore, the development of a charging infrastructure is a work in progress and likely the greatest long-term challenge for electric vehicles [5]. On the assumption that vehicles served by the gas stations will be replaced by EVs in the future, EV Charging Station facilities (CS) will be progressively built to meet this energy demand. Considering that the network inside a CS is a three-phase four-wire Low Voltage (LV) network 230/400 V, which is typical in EU and permits the connection of both AC single-phase (230 V) loads and also AC three-phase (400 V) loads. As an illustrative case, suppose that there are 10 fast DC off-board charging piles, which are three-phase AC/DC voltage source converters (VSC), of about 100 kW per pile. There is also a parking zone equipped with 20 AC charging piles, both 1-phase and 3-phase, of about 30 kW on average, and a commercial facility (about 100 square meters) for shopping and another services of about 10 kW of installed power (based on an estimation of about 100 W per square meter).

The global power will be about 1500 to 2000 kW, which is about the same as a residential building or office building [6]. A load of this magnitude is expected to require a connection to the Medium Voltage (MV) distribution network. Therefore, distribution system operators need to be informed in order to coordinate and facilitate the connection of these stations. However, the impact is not only in



terms of the power demanded. Since the chargers are based on power electronic converters, the quality of supply will also be greatly affected. From the AC side, most battery chargers on the market behave as non-linear loads, which causes harmonic distortion, reactive consumption, and imbalances. These impacts on LV networks have been extensively documented and measured [7–9]. In this paper, impact of EVs on the power distribution network is analyzed by MATLAB simulation. This paper presents harmonics and voltage profile along with the losses of distribution transformer when overloading with EV with Active Power Filter chargers.

2 Electric Vehicle Charging Station

In World, Electric vehicle charging stations are not sufficient. There are two types of charging stations exist i.e. public and private charging stations. Government has established few charging stations in different cities of World but maximum charging stations are private. These private charging stations have taken a higher charging rate. Fig. 1 shows a block diagram of an EVCS which comprises transformer, rectifier and converter. Basically, rectifier and converter make a charger which used for EV charging. The specifications of EVs available in World are given in Table 1 below.

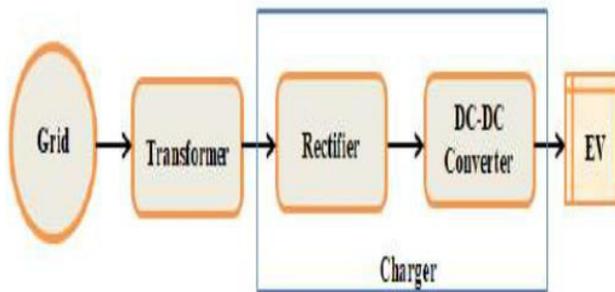


Fig.1: Block diagram of an Electric Vehicle Charging Station.

Table 1: Specifications of Electric Vehicles

Easy Bike and Auto-rickshaw	Electric motor cycle
Power: 500 W-1000 W	Power: 1000 W
Voltage: 36/48/60 V	Voltage: 48/60 V
Battery: 120 Ah-130 Ah	Battery: 14-25 Ah
Charging time: 6-7 hours	Charging time: 6-8 hours
Max. speed: 30-40 km/h	Max. speed: 50-80 km/h
Driving distance: 60-100 km	Driving distance: 40-60 km

As the EV loads are increasing day by day in a rapid manner, thus the impacts of EVs should be analyzed. The impact of mass EV penetration on power system is expressed in Fig. 2 below. Although EV penetration has cheapest transportation system, lower GHG emission facility, smart grid facilities. But negative impacts on power system network are very much significant.


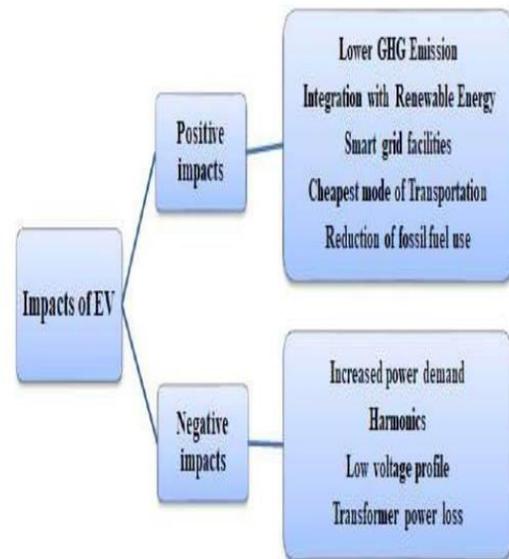


Fig. 2: Impacts of Electric Vehicle.

3 MATHEMATICAL MODELING

As a non-linear load, EV charger produces harmonics, low voltage profile and power loss in distribution transformer. In World, for EV charging level 2 type AC charging scheme is used where maximum current rating is 16 A and maximum



power rating is 3.3 kW. Most of the electric vehicles have power ranges from 0.5 kW to 1 kW and all of them use single phase 240 V, 50 Hz supply system. In this section, we have developed mathematical modeling for harmonics, voltage profile and transformer overloading due to EV charging.

3.1 Power Demand

Electric Vehicle battery takes charge from the power distribution system. The increased power demand affects the stability of the system due to non-linearity. The power demand by an EV can be expressed as in Equation (1).

$$P_{EV} = \frac{C_{Batt} * (SOC_{max} - SOC_{min})}{T_D}; \tag{1}$$

Where CBatt is the battery capacity, TD is the duration of charging. Battery SOC is a factor whether the EV takes high or small power. The gross power demand of the EVs is the summation of individual power demand of all EVs which likely signifies as in Equation (2).

$$P_{Gross} = \sum_{N=1}^N P_{EV}; \tag{2}$$

3.2 Harmonics

The rise in high frequency components of voltage and current with compared to fundamental frequency is defined as harmonics. Harmonics distorts the voltage & current waveforms and thereby affecting power quality. It can be measured by total harmonic distortion (THD) of current & voltage.

$$THD_i = \frac{\sqrt{\sum_{n=2}^N I_n^2}}{I_1} \times 100\%;$$
$$THD_v = \frac{\sqrt{\sum_{n=2}^N V_n^2}}{V_1} \times 100\%; \tag{3}$$

Equation 3 express the Total Harmonic Distortion (THD) for current and voltage respectively [6]. For slow charging THDi, THDv will be less than the fast charging. Thus, the EV with low SOC will have a great chance to produce harmonics.

3.3 Voltage profile

The low voltage profile becomes a threatening issue induced by EV charging. Voltage stability refers to the ability that the power network being stable after the sudden increase or decrease in the loads. EV loads take large amount of power at a very short duration. Thus, voltage profile will be degraded and grid will be unstable.

3.4 Transformer performance

Mass deployment of EVs creates an additional stress on distribution transformers and their life cycles. Another problem is that, the EV charging rate should be limited per day and charging stations should keep far away from transformer for reducing power loss. Harmonic current is responsible for occurring load losses in transformer whereas harmonic voltage incurs no load loss. Due to these harmonic losses, heating is increased relative to the pure sinusoidal wave. This harmonic withstand capability can be measured by a factor called k- factor.

$$K - factor = \sum_{n=1}^N n^2 \left[\frac{I_n}{I_R} \right]^2; \tag{4}$$

In is the current related to nth harmonic and IR is the rated load current. The presence of harmonics causes overheating in the transformer. Thus, the transformer should be selected according to the withstand capability at higher harmonic current for non-linear loading [7].

(4) ACTIVE POWER FILTER

The increasing use of power electronics-based loads (adjustable speed drives, switch mode power supplies, etc.) to improve system efficiency and controllability is increasing the concern for harmonic distortion levels in end use facilities and on the overall power system. The application of passive tuned filters creates new system resonances which are dependent on specific system conditions. In addition, passive filters often need to be significantly overrated to account for possible harmonic absorption from the power system. Passive filter ratings must be coordinated with reactive power requirements of the loads and it is often difficult to design the filters to avoid leading power factor operation for some load conditions. Active filters have the advantage of being able to compensate for harmonics without fundamental frequency reactive power concerns. This means that the rating of the active power can be less than a comparable passive filter for the same

distribution network for charging, the aggregated effects of harmonics can be threat for the whole power system. In the MATLAB Simulink modeling, the harmonics generated at the different ratio of EV charging is shown in below Fig. 4, 5, 6.

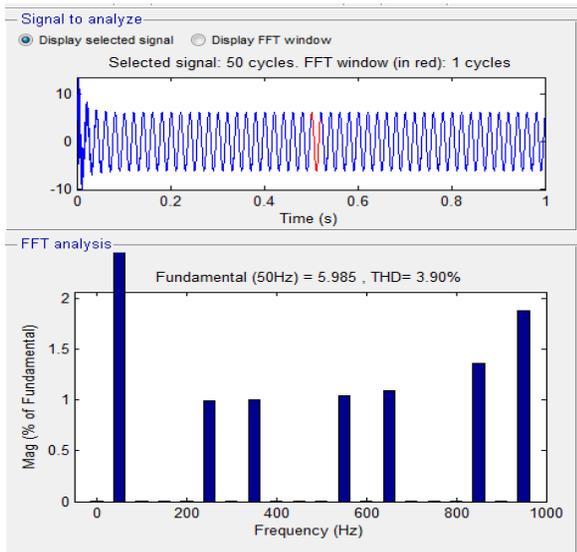


Fig. 4 Harmonics, when single EV is connected at a charging station

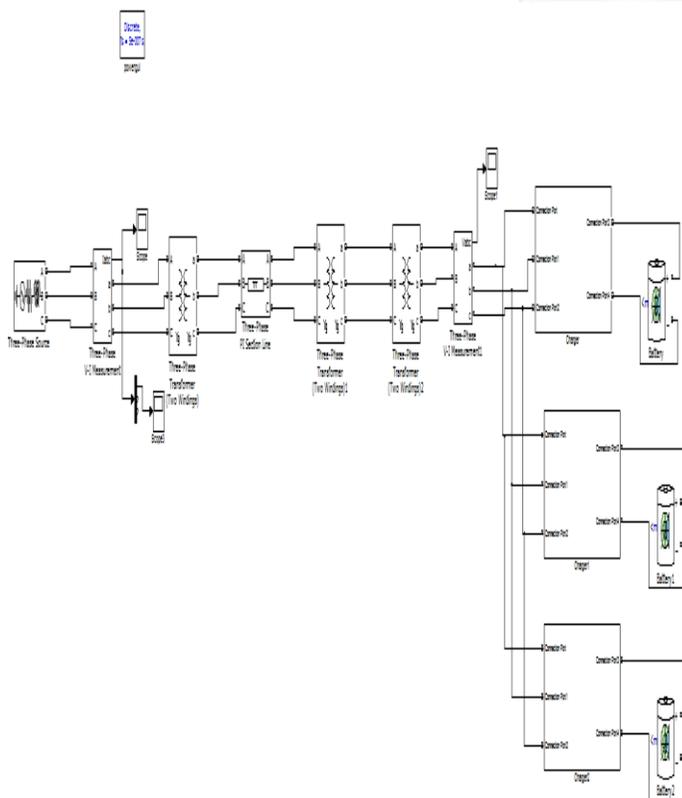


Fig 5 Simulink diagram of Proposed System is when three EV is connected at a charging station

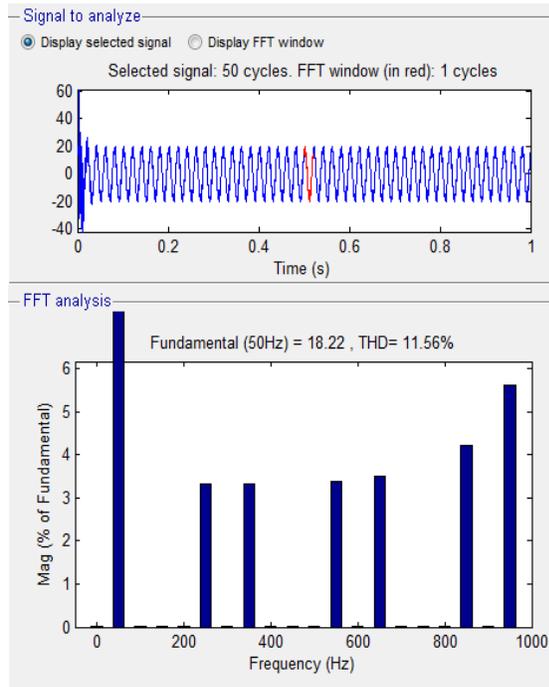


Fig. 6 Harmonics, when 3 EV chargers are connected at a charging station

Fig 7 Simulink diagram of Proposed System is when five EV is connected at a charging station


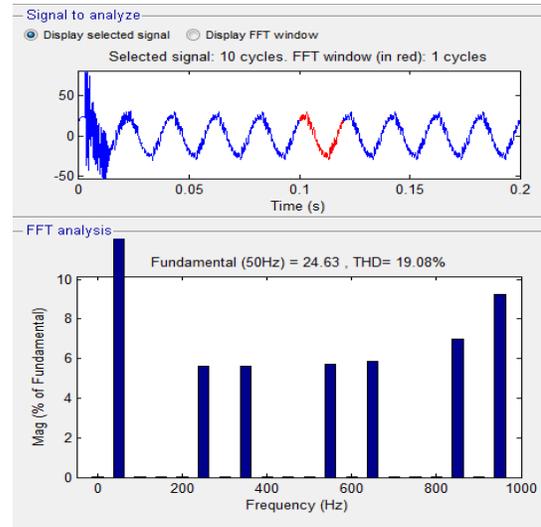


Fig. 8 Harmonics, when 5 EV chargers are connected at a charging station

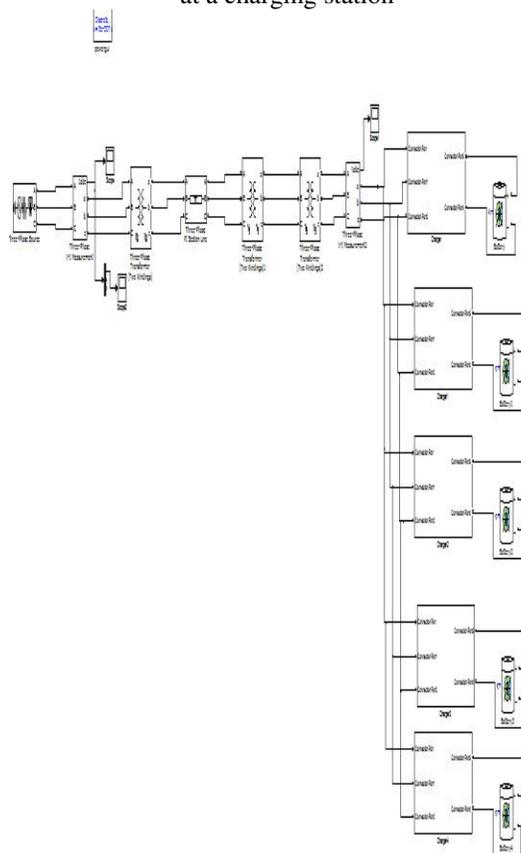

Voltage at the distribution end also reduces when multiple EV chargers are connected. The overloading due to large number of EVs causes this problem. The voltage profile variation before connecting EV charger and after connecting EV charger is shown in Fig. 10 & 11. Fig. 11 shows that, the voltage is affected by harmonics disturbance compared to the voltage without connection of EV chargers in Fig. 10. In the Fig. 11, it is seen that voltage sag and swelling occurs with harmonic disturbances.

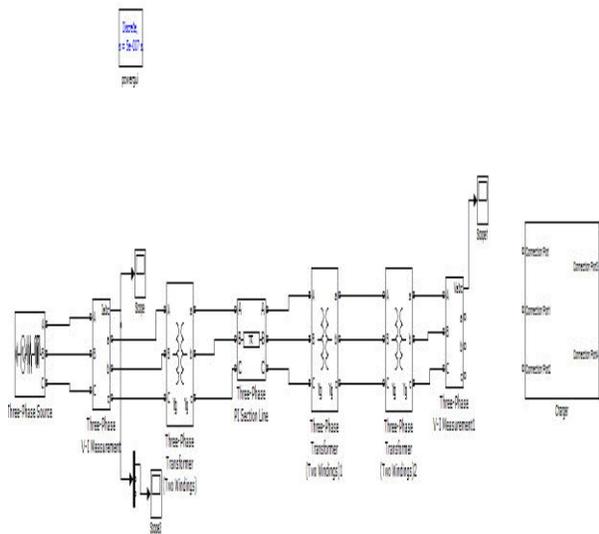


figure 9 Simulink diagram of proposed system before connecting Charger.



Figure10 Input Voltage, before connecting Charger.

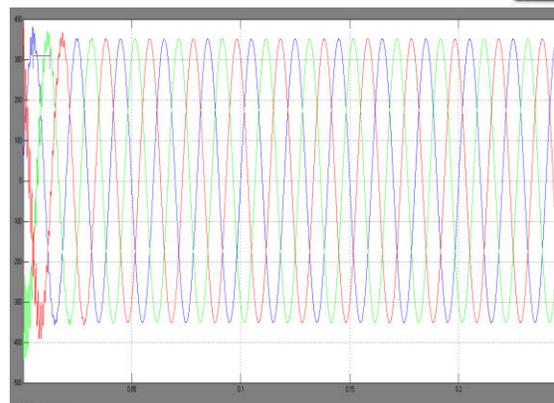


Fig. 11 Input Voltage, after connecting Charger.

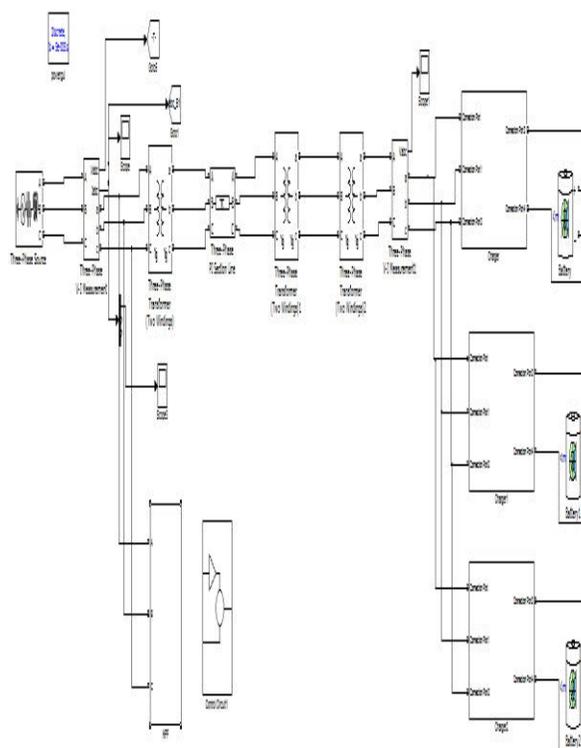


Figure12 Simulink diagram of proposed system(3 EV chargers are connected at a charging station) with Active Power Filter.

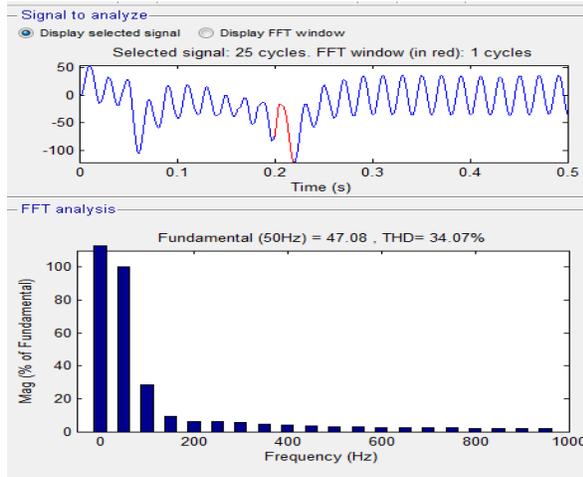


Fig. 13 Harmonics, when 3 EV chargers are connected at a charging station with charging Station with Active Power Filter.

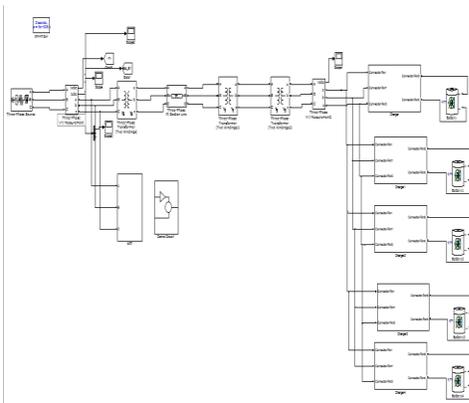


Figure 14 Simulink diagram of proposed system (5 EV chargers are connected at a charging station) with Active Power Filter.

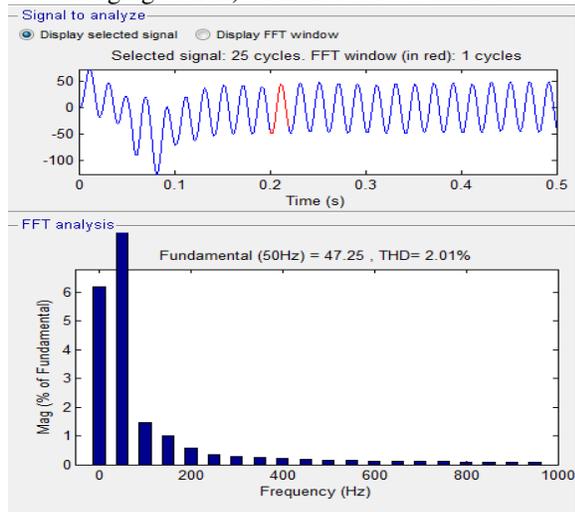


Figure 15 Harmonics, when 5 EV chargers are connected at a charging station with charging Station with Active Power Filter.

(6) CONCLUSION

Prominent features of less environmental pollution & cheapest mode of transportation makes EV market more attractive to the consumers. As maximum EVs are charged at residential connection due to the lack of charging stations with filters in World, the power sector has been failed to earn the profit from this sector. However, due to some reasons EVs with filters penetration makes power system more vulnerable and hampers power quality. In this paper, the power quality issues like harmonics, voltage fluctuation, transformer power losses are analyzed using MATLAB Simulink in the context of World power sector. In addition to this, the mitigation technique with filters using available renewable resources is also discussed in this paper. Although the EVs with filters have several benefits as like stabilizing the grid at under loaded condition, lower GHG emission but the power quality issues should regulate properly for sustainable development in the power sector.

REFERENCES

1. World Road Transport Authority (BRTA). Available Online: www.brt.gov.bd (accessed on 29.10.2018).
2. PDB for bringing battery-run vehicles under tariff regulations. Available Online: <https://www.dhakatribune.com/world/powerenergy/2017/09/27/pdbbringingbatteryrunvehicles-tariff-regulations/> (accessed on 29.10.2018).
3. AK Karmaker, MR Ahmed, MA Hossain, and MM Sikder. "Feasibility assessment & design of hybrid renewable energy based electric vehicle charging station in World." *Sustainable Cities and Society* 39 (2018): 189- 202.
4. Durante, Larry, Matthew Nielsen, and Prasanta Ghosh. "Analysis of non-sinusoidal wave generation during electric vehicle charging and their impacts on the power system." *International Journal of Process Systems Engineering* 4, no. 2-3 (2017): 138-150.
5. Godina, Radu, Eduardo MG Rodrigues, N. G. Paterakis, OzanErdinc, and Joao PS Catalao. "Innovative impact assessment of electric vehicles charging loads on distribution transformers using real data." *Energy Conversion and Management* 120 (2016): 206-216.
6. Un-Noor, Fuad, SanjeevikumarPadmanaban, Lucian MihetPopa, Mohammad NurunnabiMollah, and Eklas Hossain. "A comprehensive study of key electric vehicle (EV) components, technologies, challenges, impacts, and future direction of development." *Energies* 10, no. 8 (2017): 1217.
7. Wetzter, Jos. "Operation of transformers: Impact of harmonic loading on transformer losses." *Transformers Magazine* 5, no. 1 (2018): 74-79.
8. World Power Development Board (BPDB). Online: www.bpdb.gov.bd (accessed on 29.10.2018).